



**NOVEMBER
METRO LIMITS**

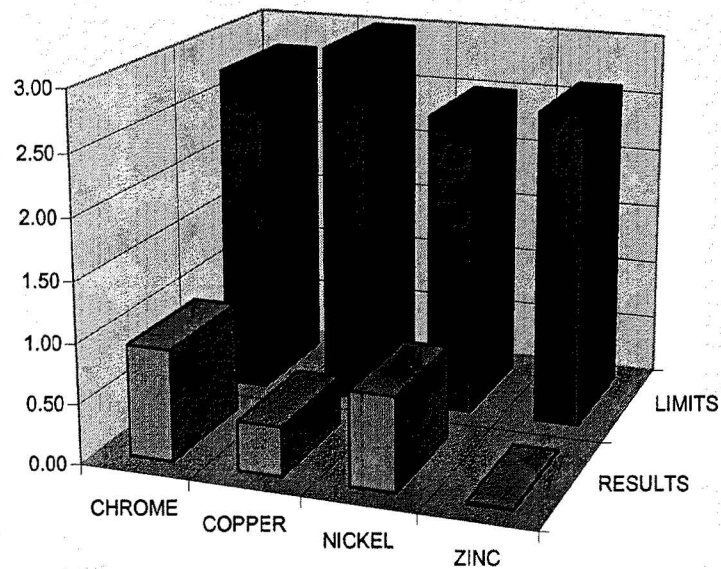

ALASKAN COPPER WORKS
3200 FACILITY
NOVEMBER 1, 2007
COMPOSITE M117902

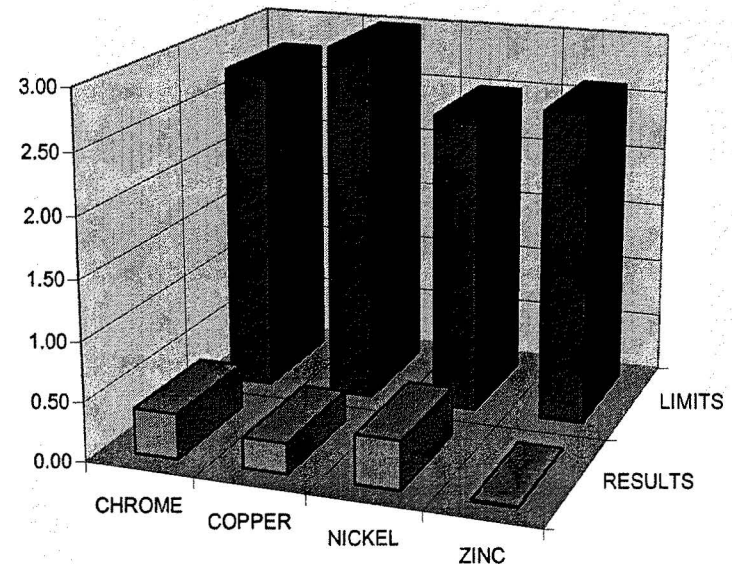

ALASKAN COPPER WORKS
3200 FACILITY
NOVEMBER 8, 2007
GRAB M01455


VISUAL REPRESENTATION OF THE LAB RESULTS

NOTE: ALL LABORATORY RESULTS HAVE BEEN CHANGED FROM ppb TO ppm FOR REPORTING PURPOSES


	CHROME	COPPER	NICKEL	ZINC
RESULTS	0.93	0.41	0.78	0.01
LIMITS	2.75	3.00	2.50	2.61

	CHROME	COPPER	NICKEL	ZINC
RESULTS	0.38	0.26	0.41	0.01
LIMITS	2.75	3.00	2.50	2.61

**NOVEMBER
METRO LIMITS**

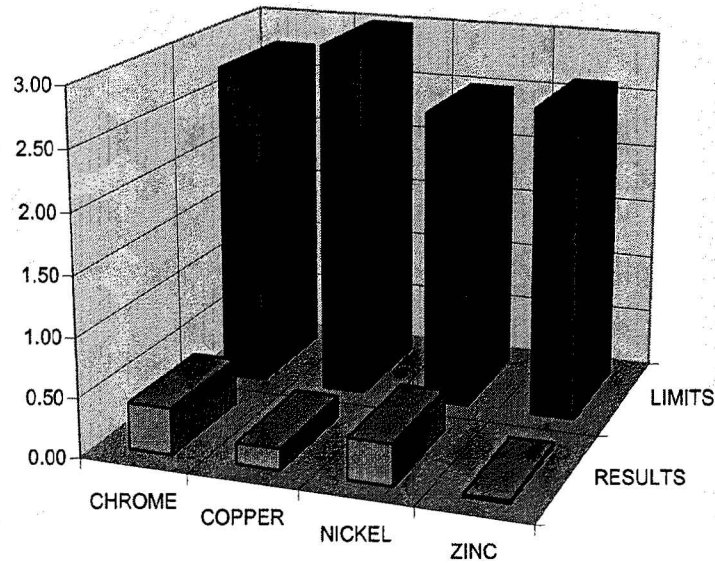

ALASKAN COPPER WORKS
3200 FACILITY
NOVEMBER 15, 2007
COMPOSITE M117961

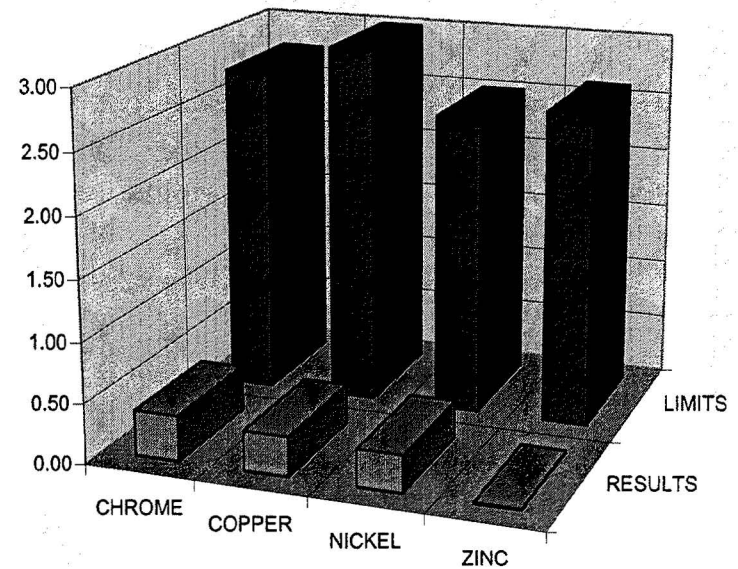

ALASKAN COPPER WORKS
3200 FACILITY
NOVEMBER 20, 2007
COMPOSITE M01036


VISUAL REPRESENTATION OF THE LAB RESULTS

NOTE: ALL LABORATORY RESULTS HAVE BEEN CHANGED FROM ppb TO ppm FOR REPORTING PURPOSES

	CHROME	COPPER	NICKEL	ZINC
RESULTS	0.39	0.18	0.35	0.02
LIMITS	2.75	3.00	2.50	2.61

	CHROME	COPPER	NICKEL	ZINC
RESULTS	0.38	0.33	0.31	0.01
LIMITS	2.75	3.00	2.50	2.61

**NOVEMBER
METRO LIMITS**

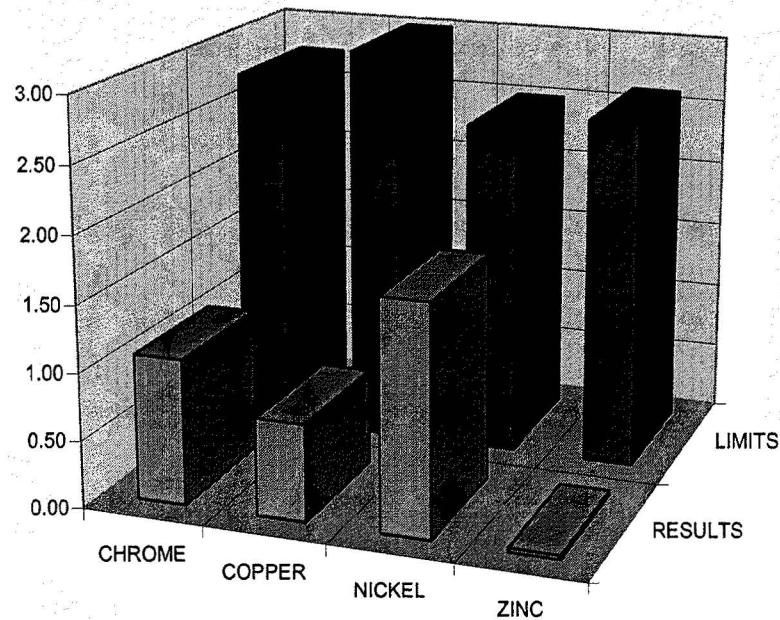

ALASKAN COPPER WORKS

3200 FACILITY

NOVEMBER 29, 2007

COMPOSITE M01587

VISUAL REPRESENTATION OF THE LAB RESULTS

NOTE: ALL LABORATORY RESULTS HAVE BEEN CHANGED FROM ppb TO ppm FOR REPORTING PURPOSES

	CHROME	COPPER	NICKEL	ZINC
RESULTS	1.08	0.72	1.71	0.03
LIMITS	2.75	3.00	2.50	2.61